




Rough In Diagram

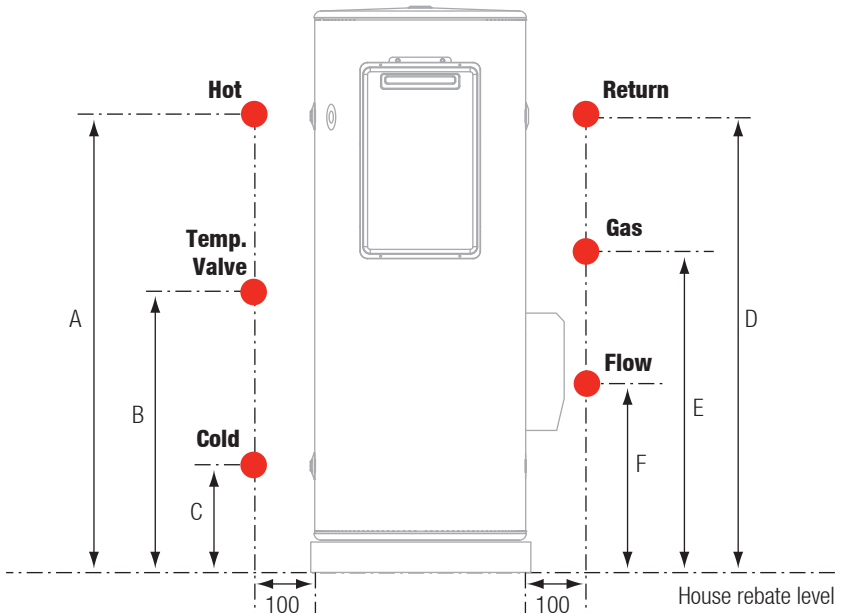

- Approximate location of pipework. A tolerance of 25mm is acceptable to dimensions shown in table below.

Note: Ensure pipes protrude horizontally from wall, and leave enough length of pipe to allow easy connections.

		250 L	315 L	400 L
	Tank Height	1444	1754	1703
	Overall diameter	617	617	705
A	Hot water outlet	1230	1300	1450
B	Tempered water outlet (mid-way between A and C)	505	540	615
C	Cold water inlet	220	220	220
D	Return from solar collectors	1231	1541	1466
E	Gas entry	770	820	820
F	Flow to solar collectors	600	600	600